EXHIBIT 2
DATE 2-23-07
HB 628

Facility No. 56 - 08318 Date 2/24/99

GENERAL SITE PLAN

Show location of tanks, piping, fill pipes, dispensers, vents, monitoring points for cathodic protection, location of monitoring wells, buildings on property site, distances to property lines/buildings, utility corridors, all domestic wells and surface waters within 50' of site, and direction of ground slope.

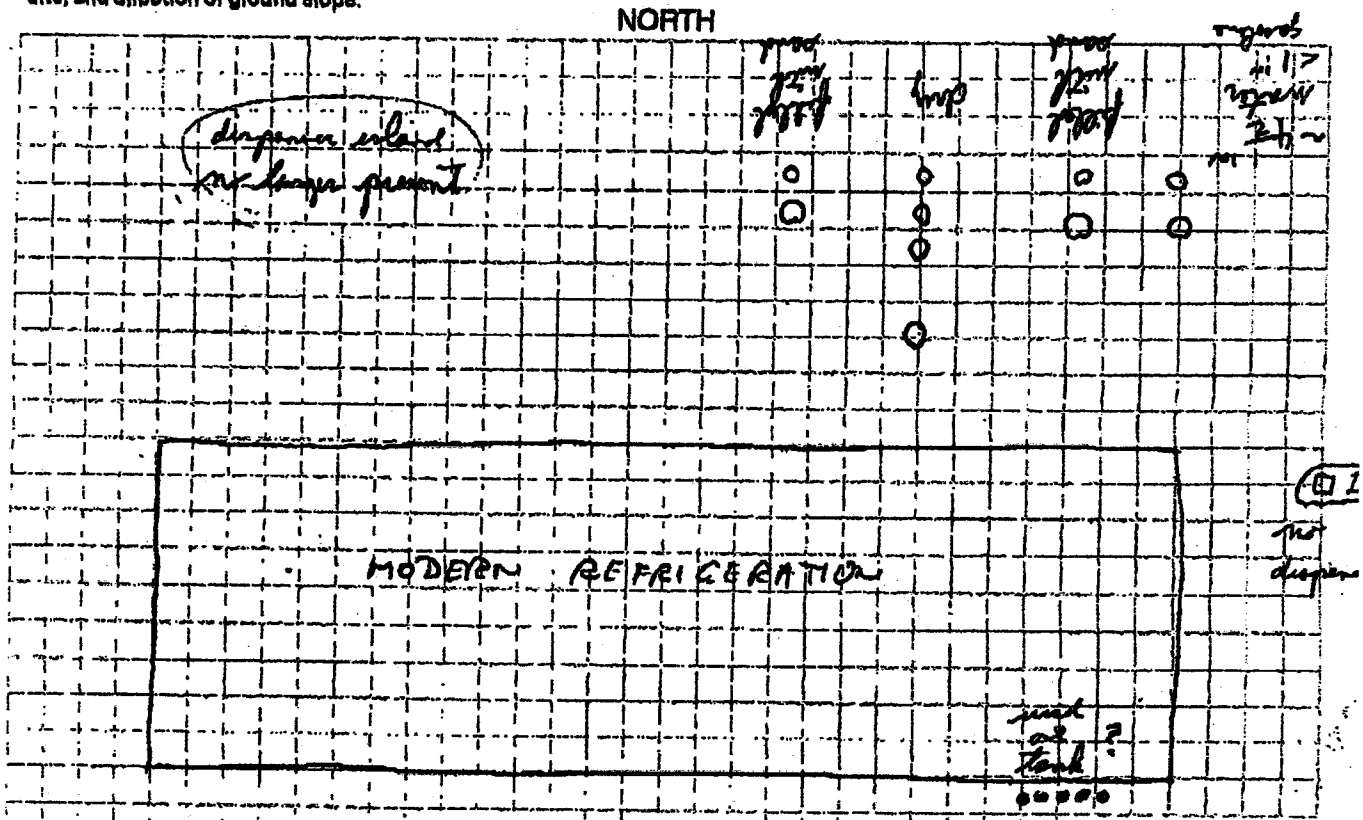

These UST systems were last used about 1984. Since they were taken out of service prior to the enactment of UST closure requirements in 1989 and attempts were made to close the UST systems (e.g. 2 were filled with sand, and dispensers were removed) these are mostly little tanks and can be designated.

SCALE: _____ inch = _____ feet

Billings

Curtis Ford Inc

David J. Karlen

Department — White Inspector — Yellow Owner — Pink

9/96