EXHIBIT 3
DATE 2/16/2011
HB 504

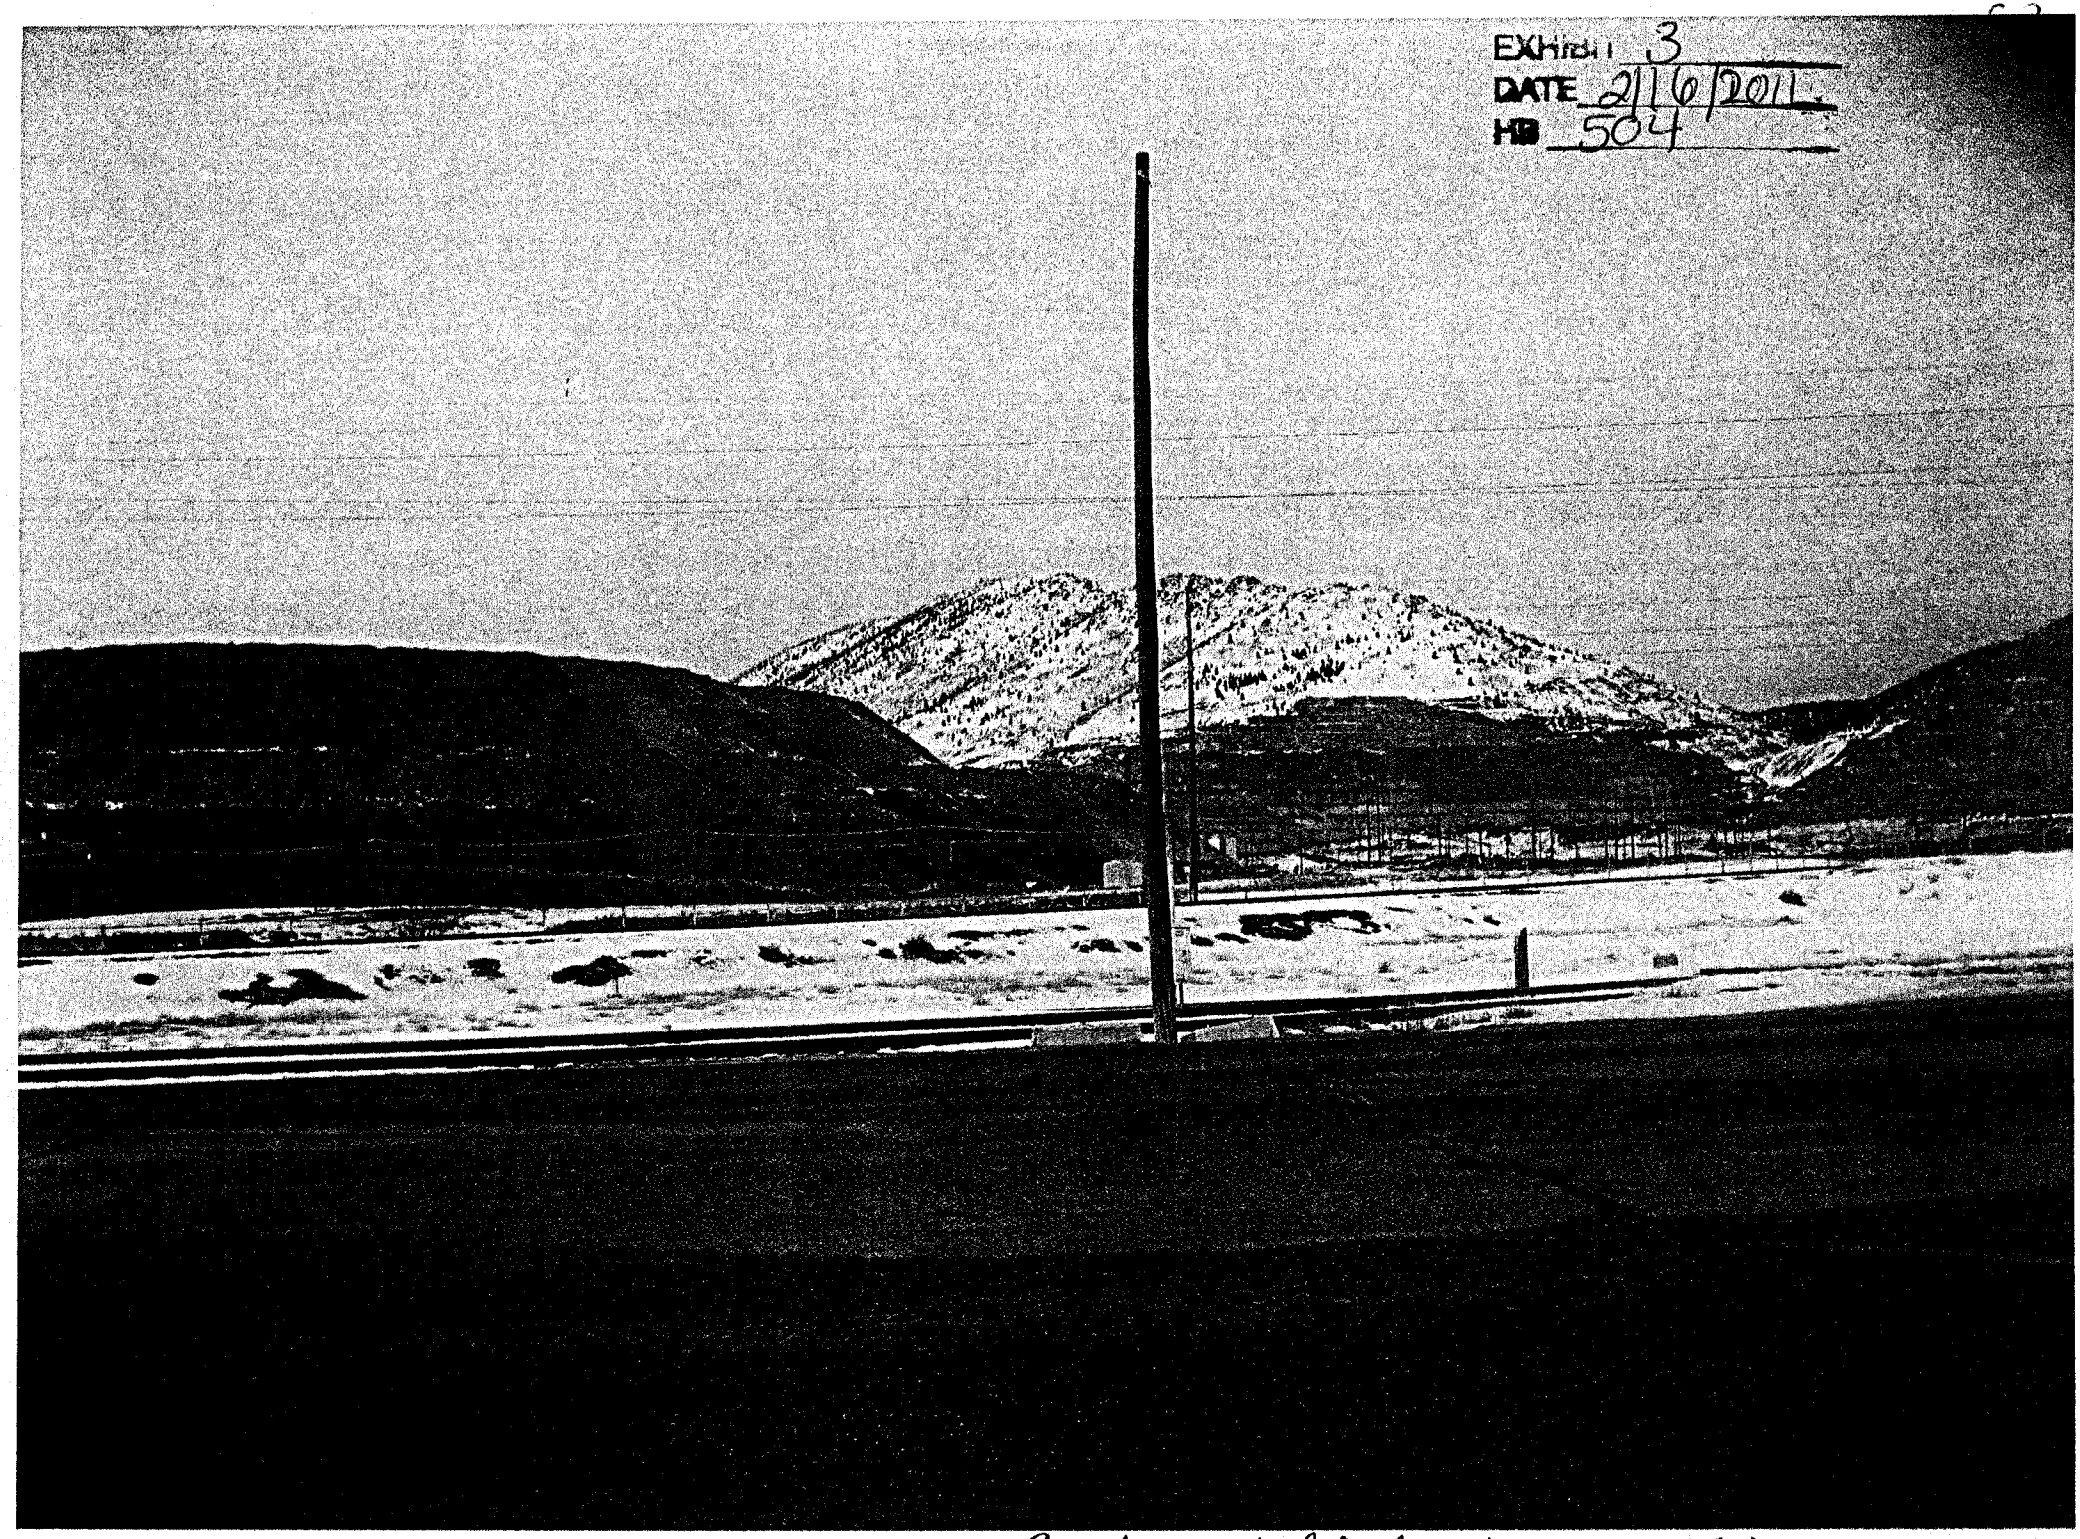

Continental in front of MRT (2)

Simulation One
View Looking Northwest from Spur Lane

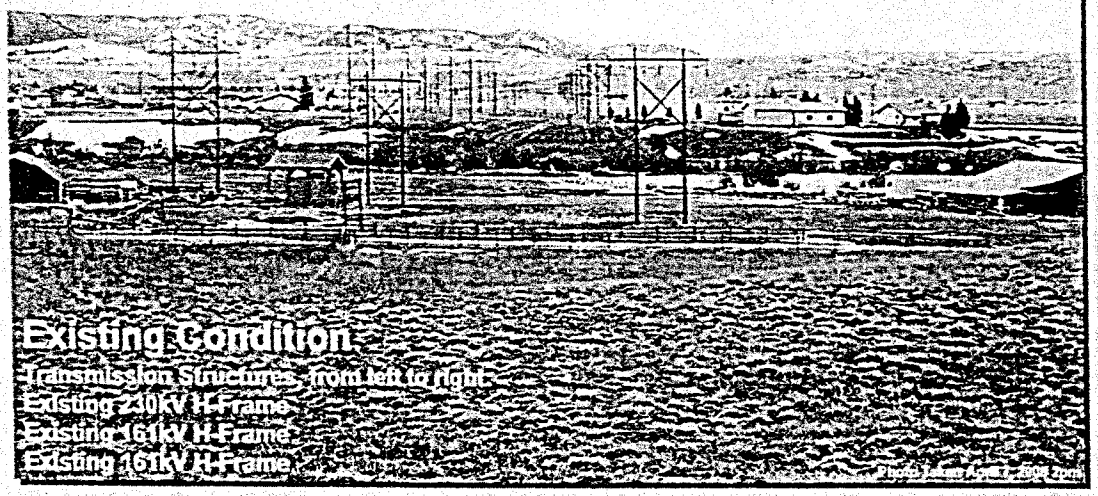

Existing Condition

Transmission Structures, from left to right:
Existing 230kV H-Frame
Existing 161kV H-Frame
Existing 161kV H-Frame

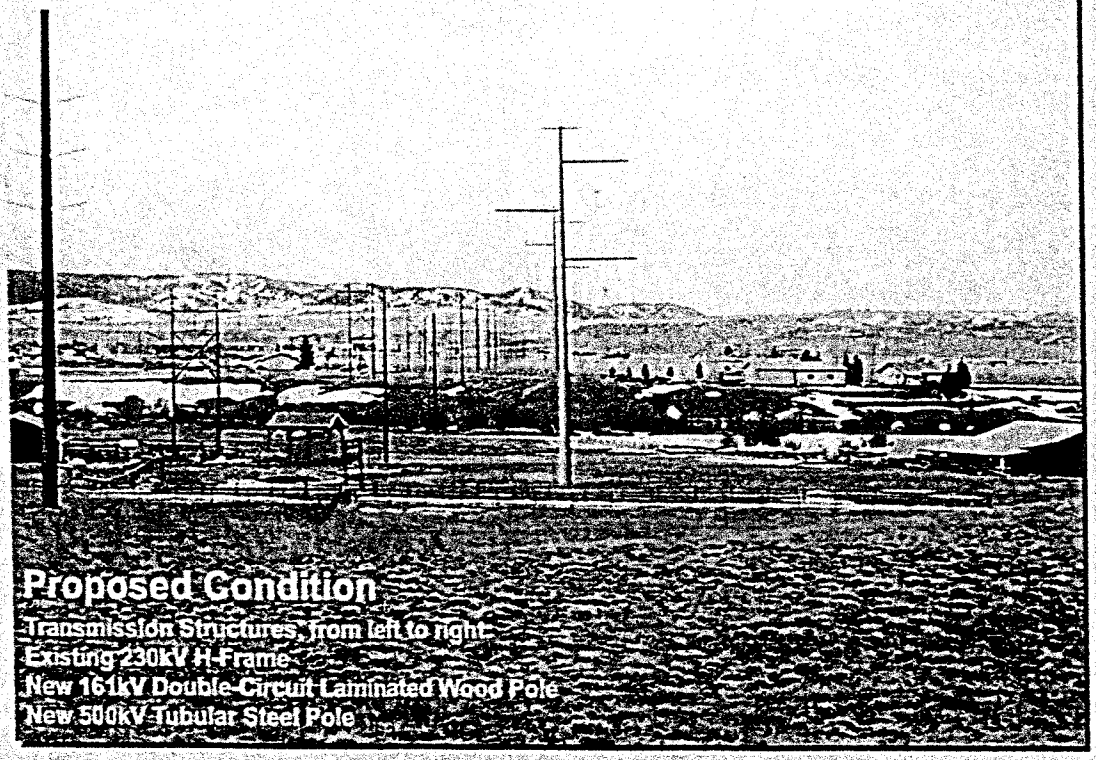

Proposed Condition

Transmission Structures, from left to right:
Existing 230kV H-Frame
New 161kV Double-Circuit Laminated Wood Pole
New 500kV Tubular Steel Pole

MOUNTAIN STATES TRANSMISSION INTERTIE

NorthWestern Energy

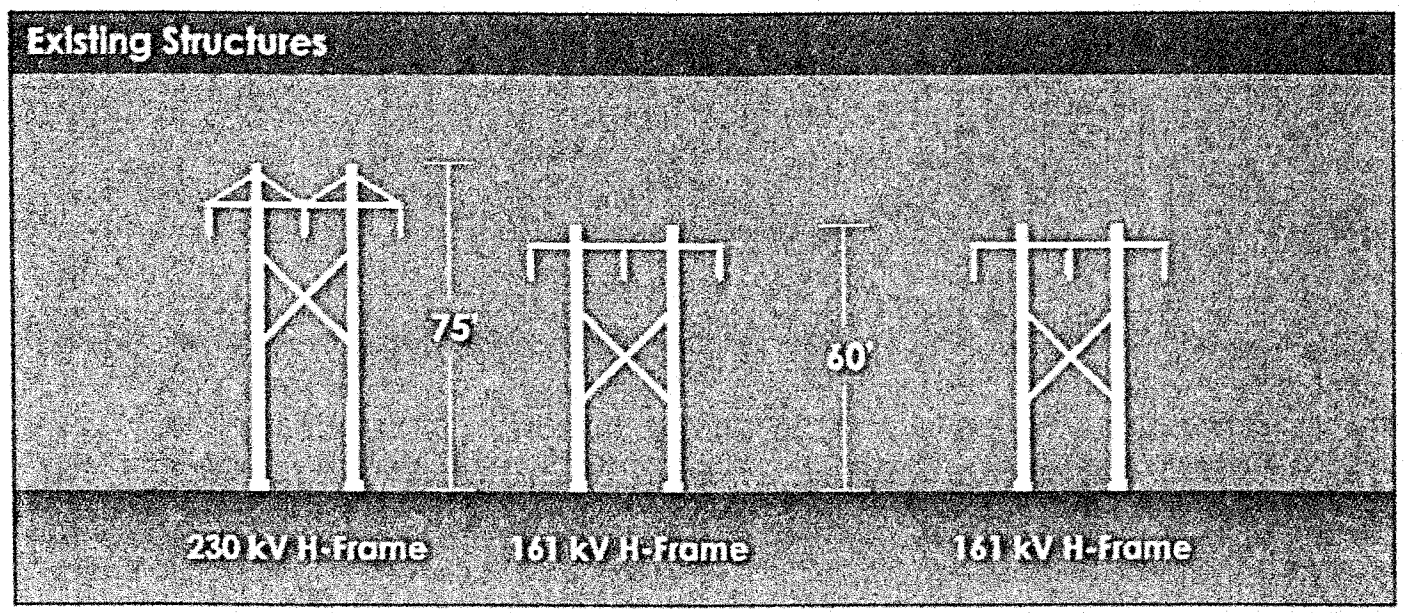
Existing Structures
75'
60'
230 kV H-Frame
161 kV H-Frame
161 kV H-Frame

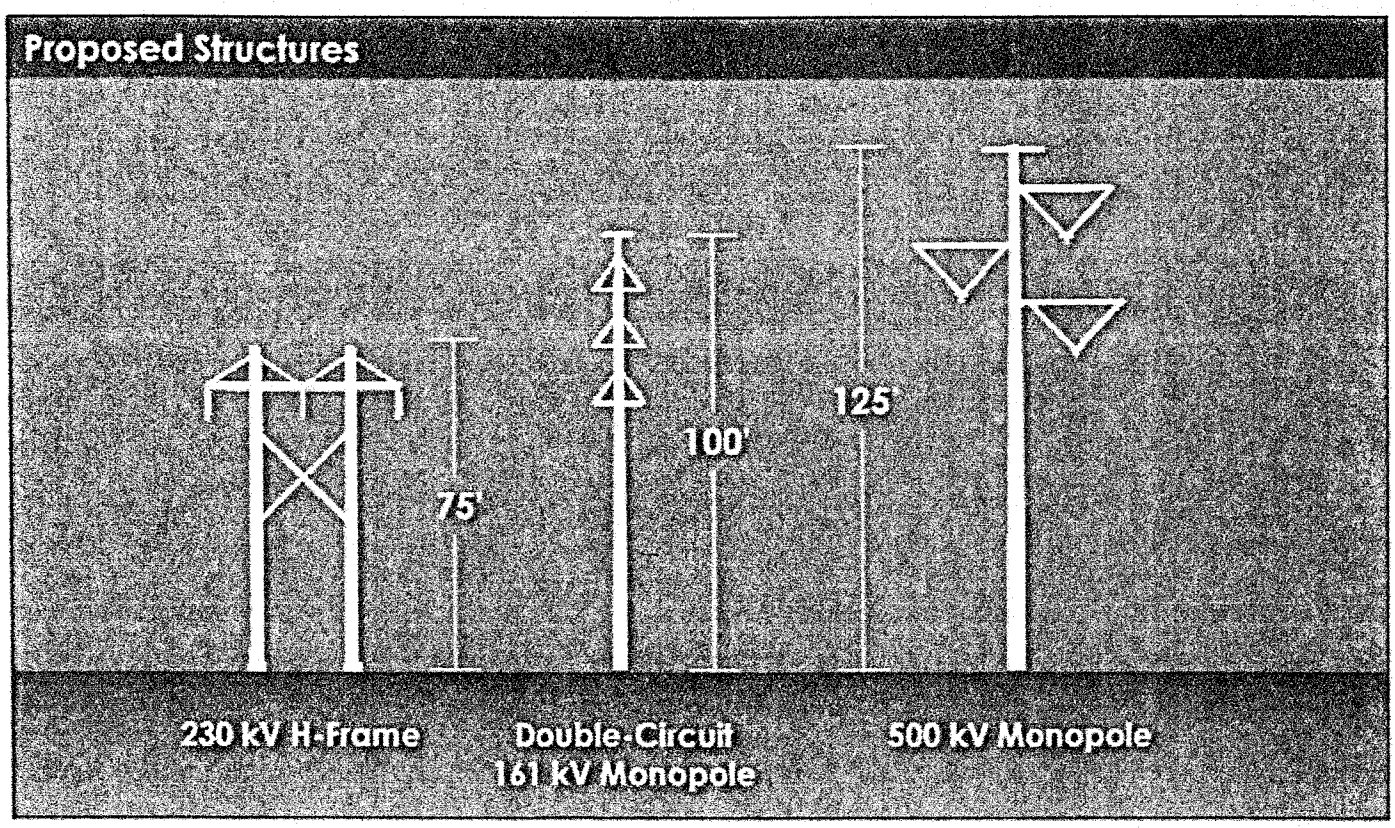
Proposed Structures
75'
100'
125'
230 kV H-Frame
Double-Circuit
161 kV Monopole
500 kV Monopole

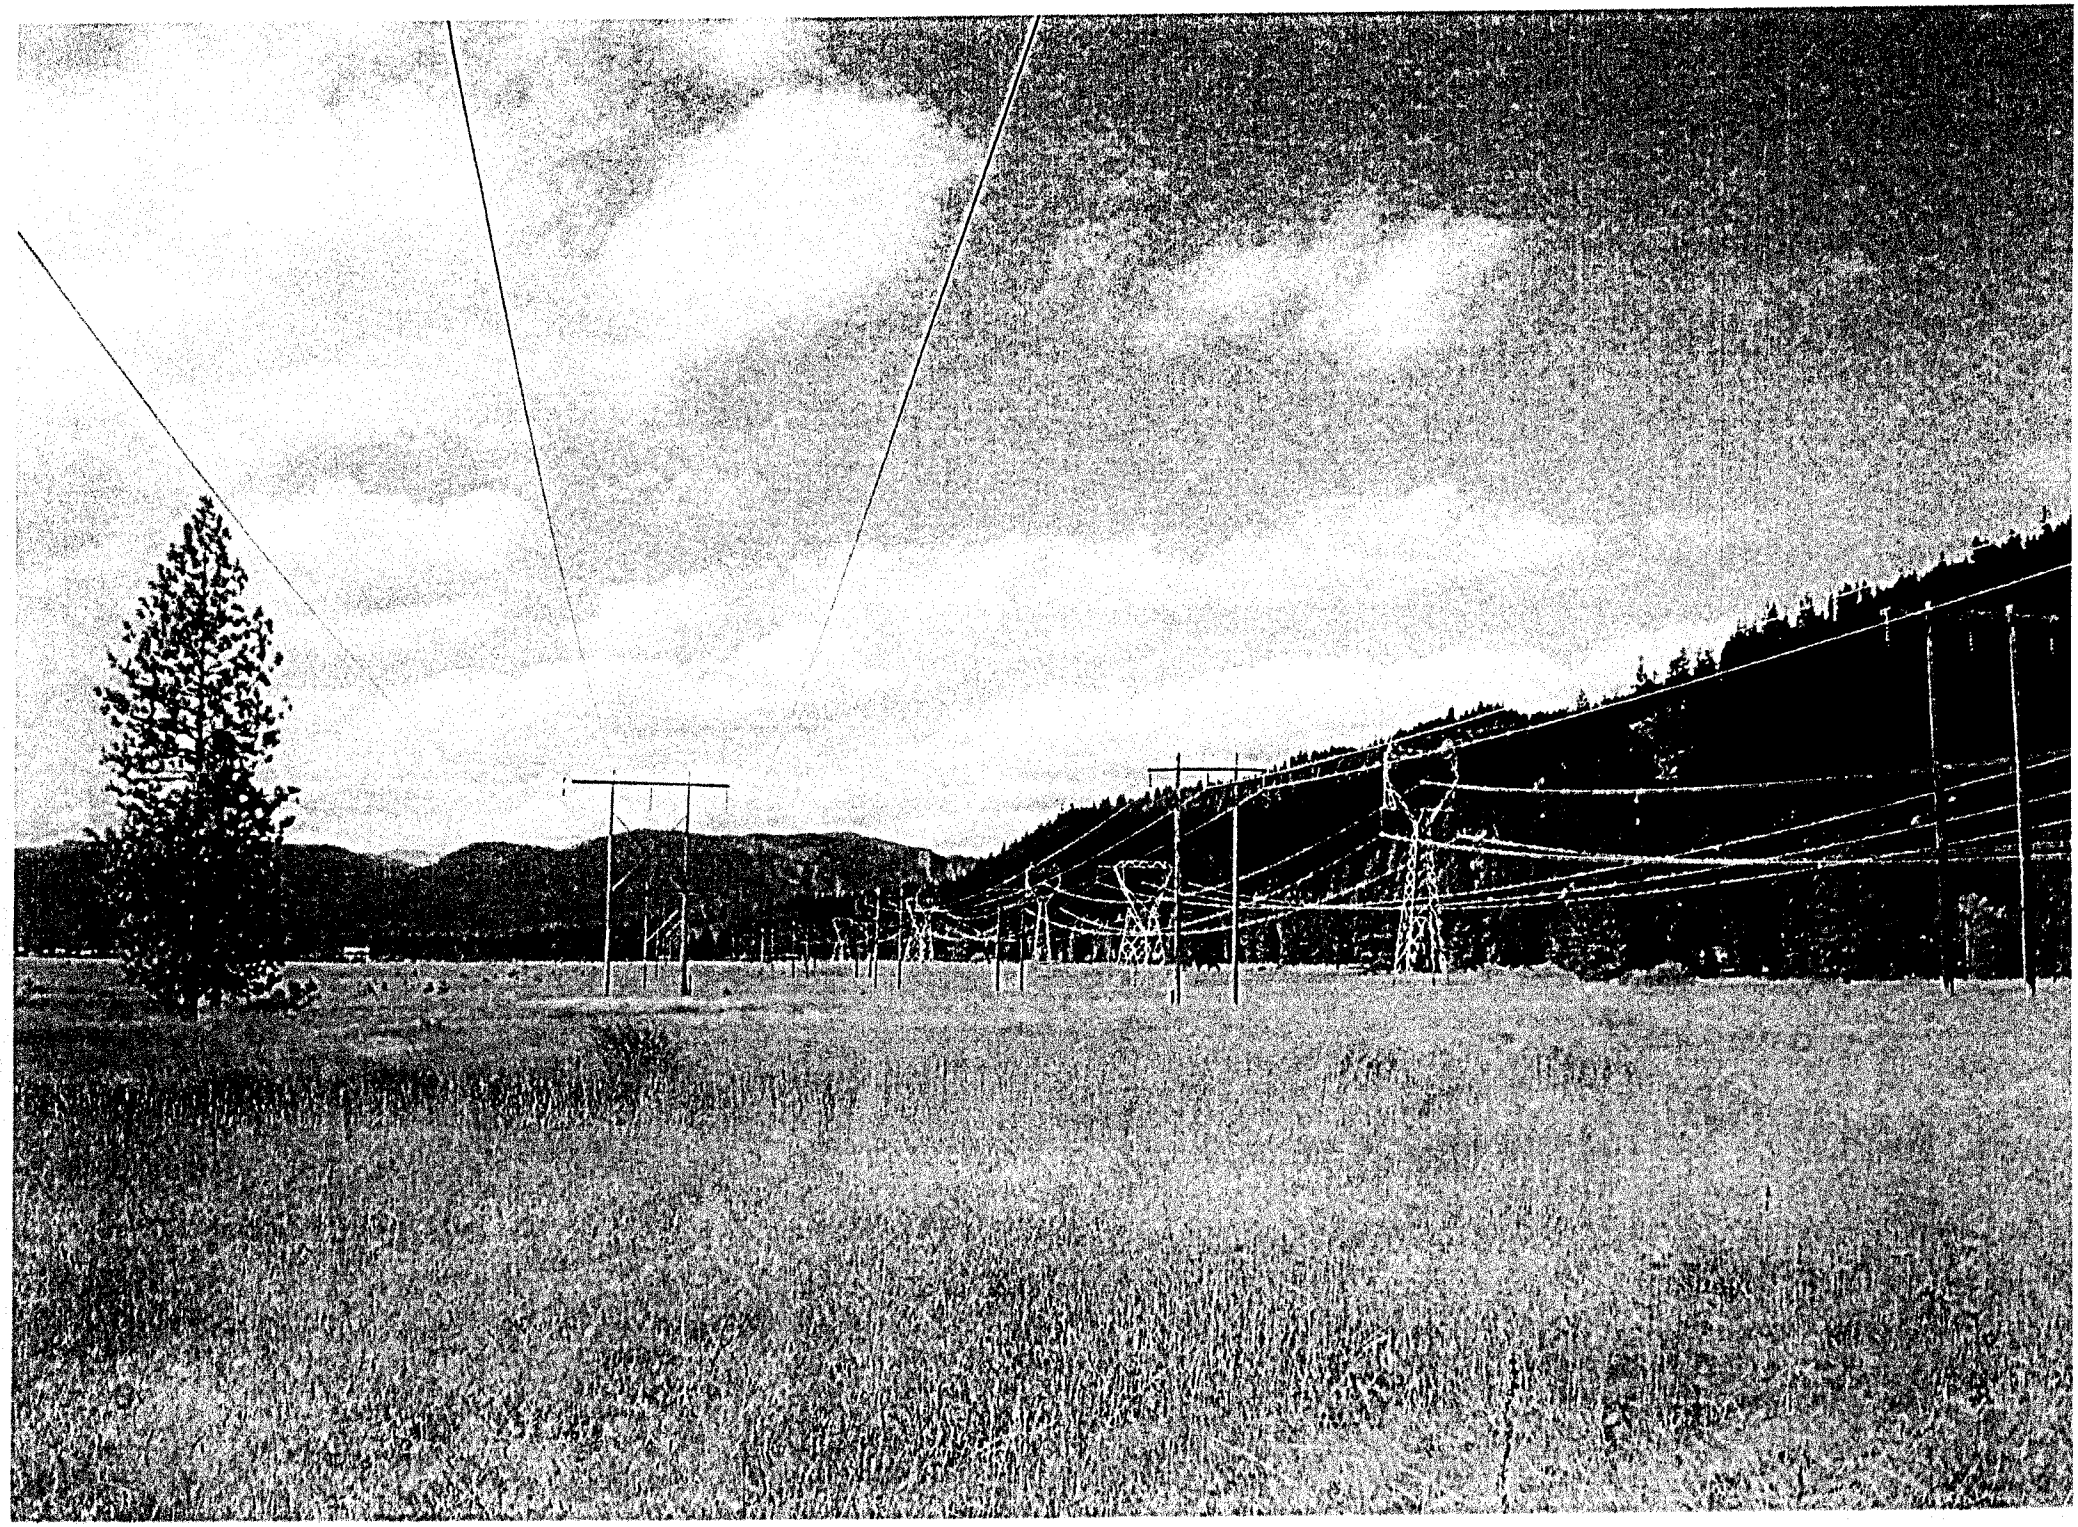

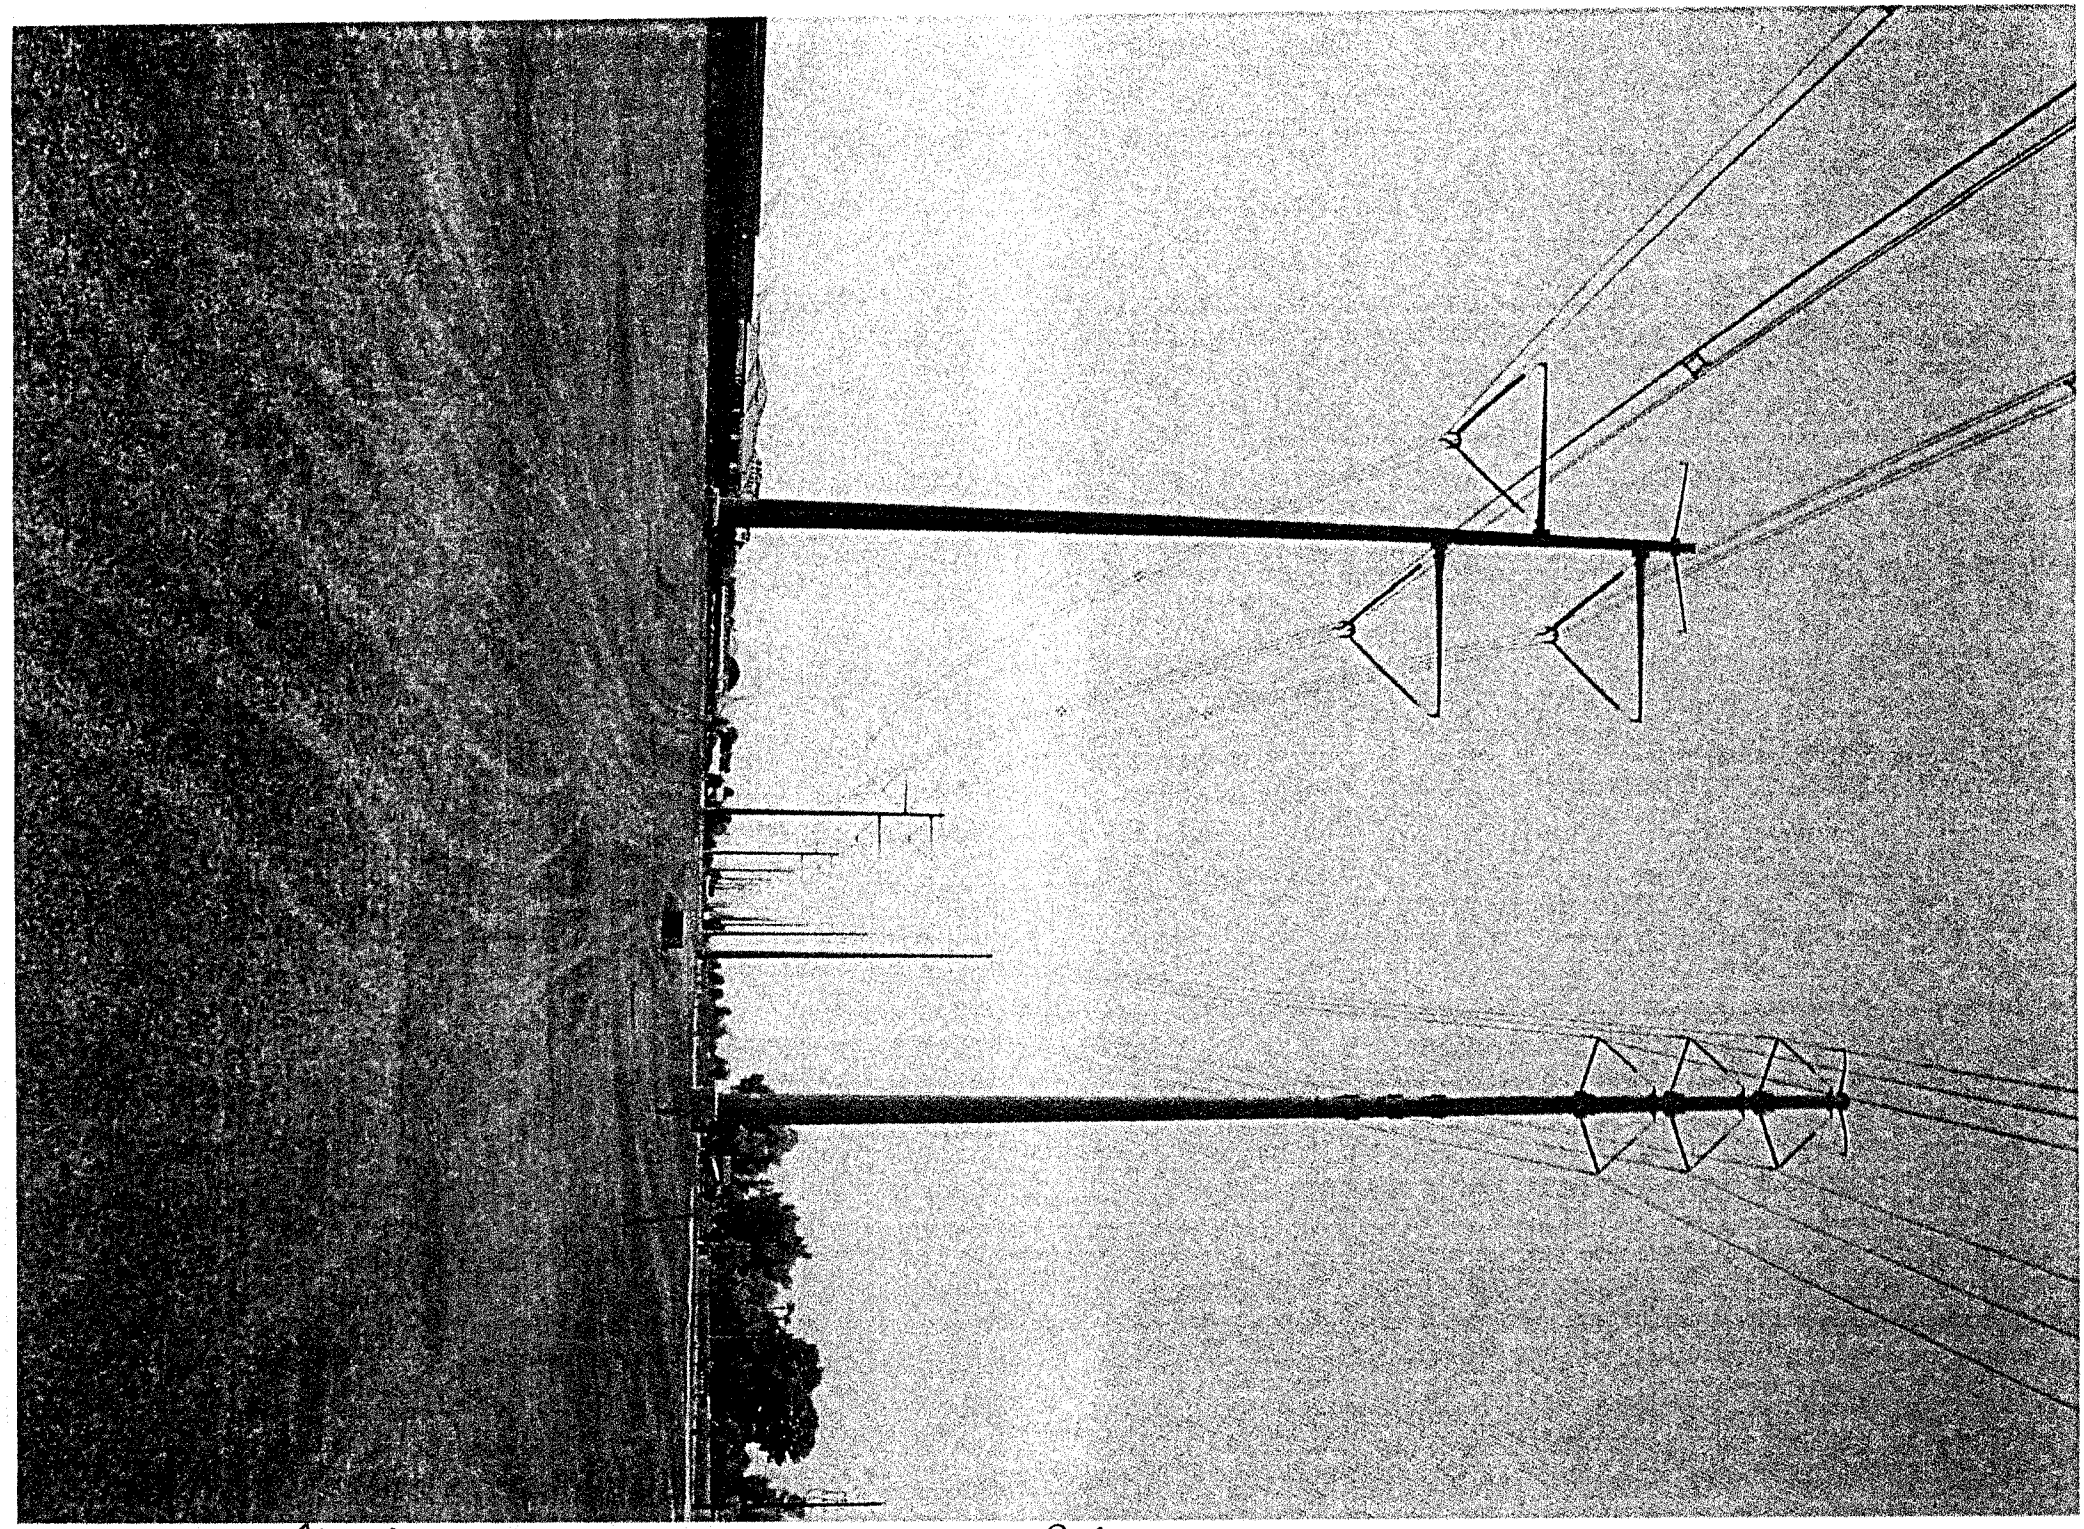

500kV Delta Pole / 230 kV Double Circuit Pole

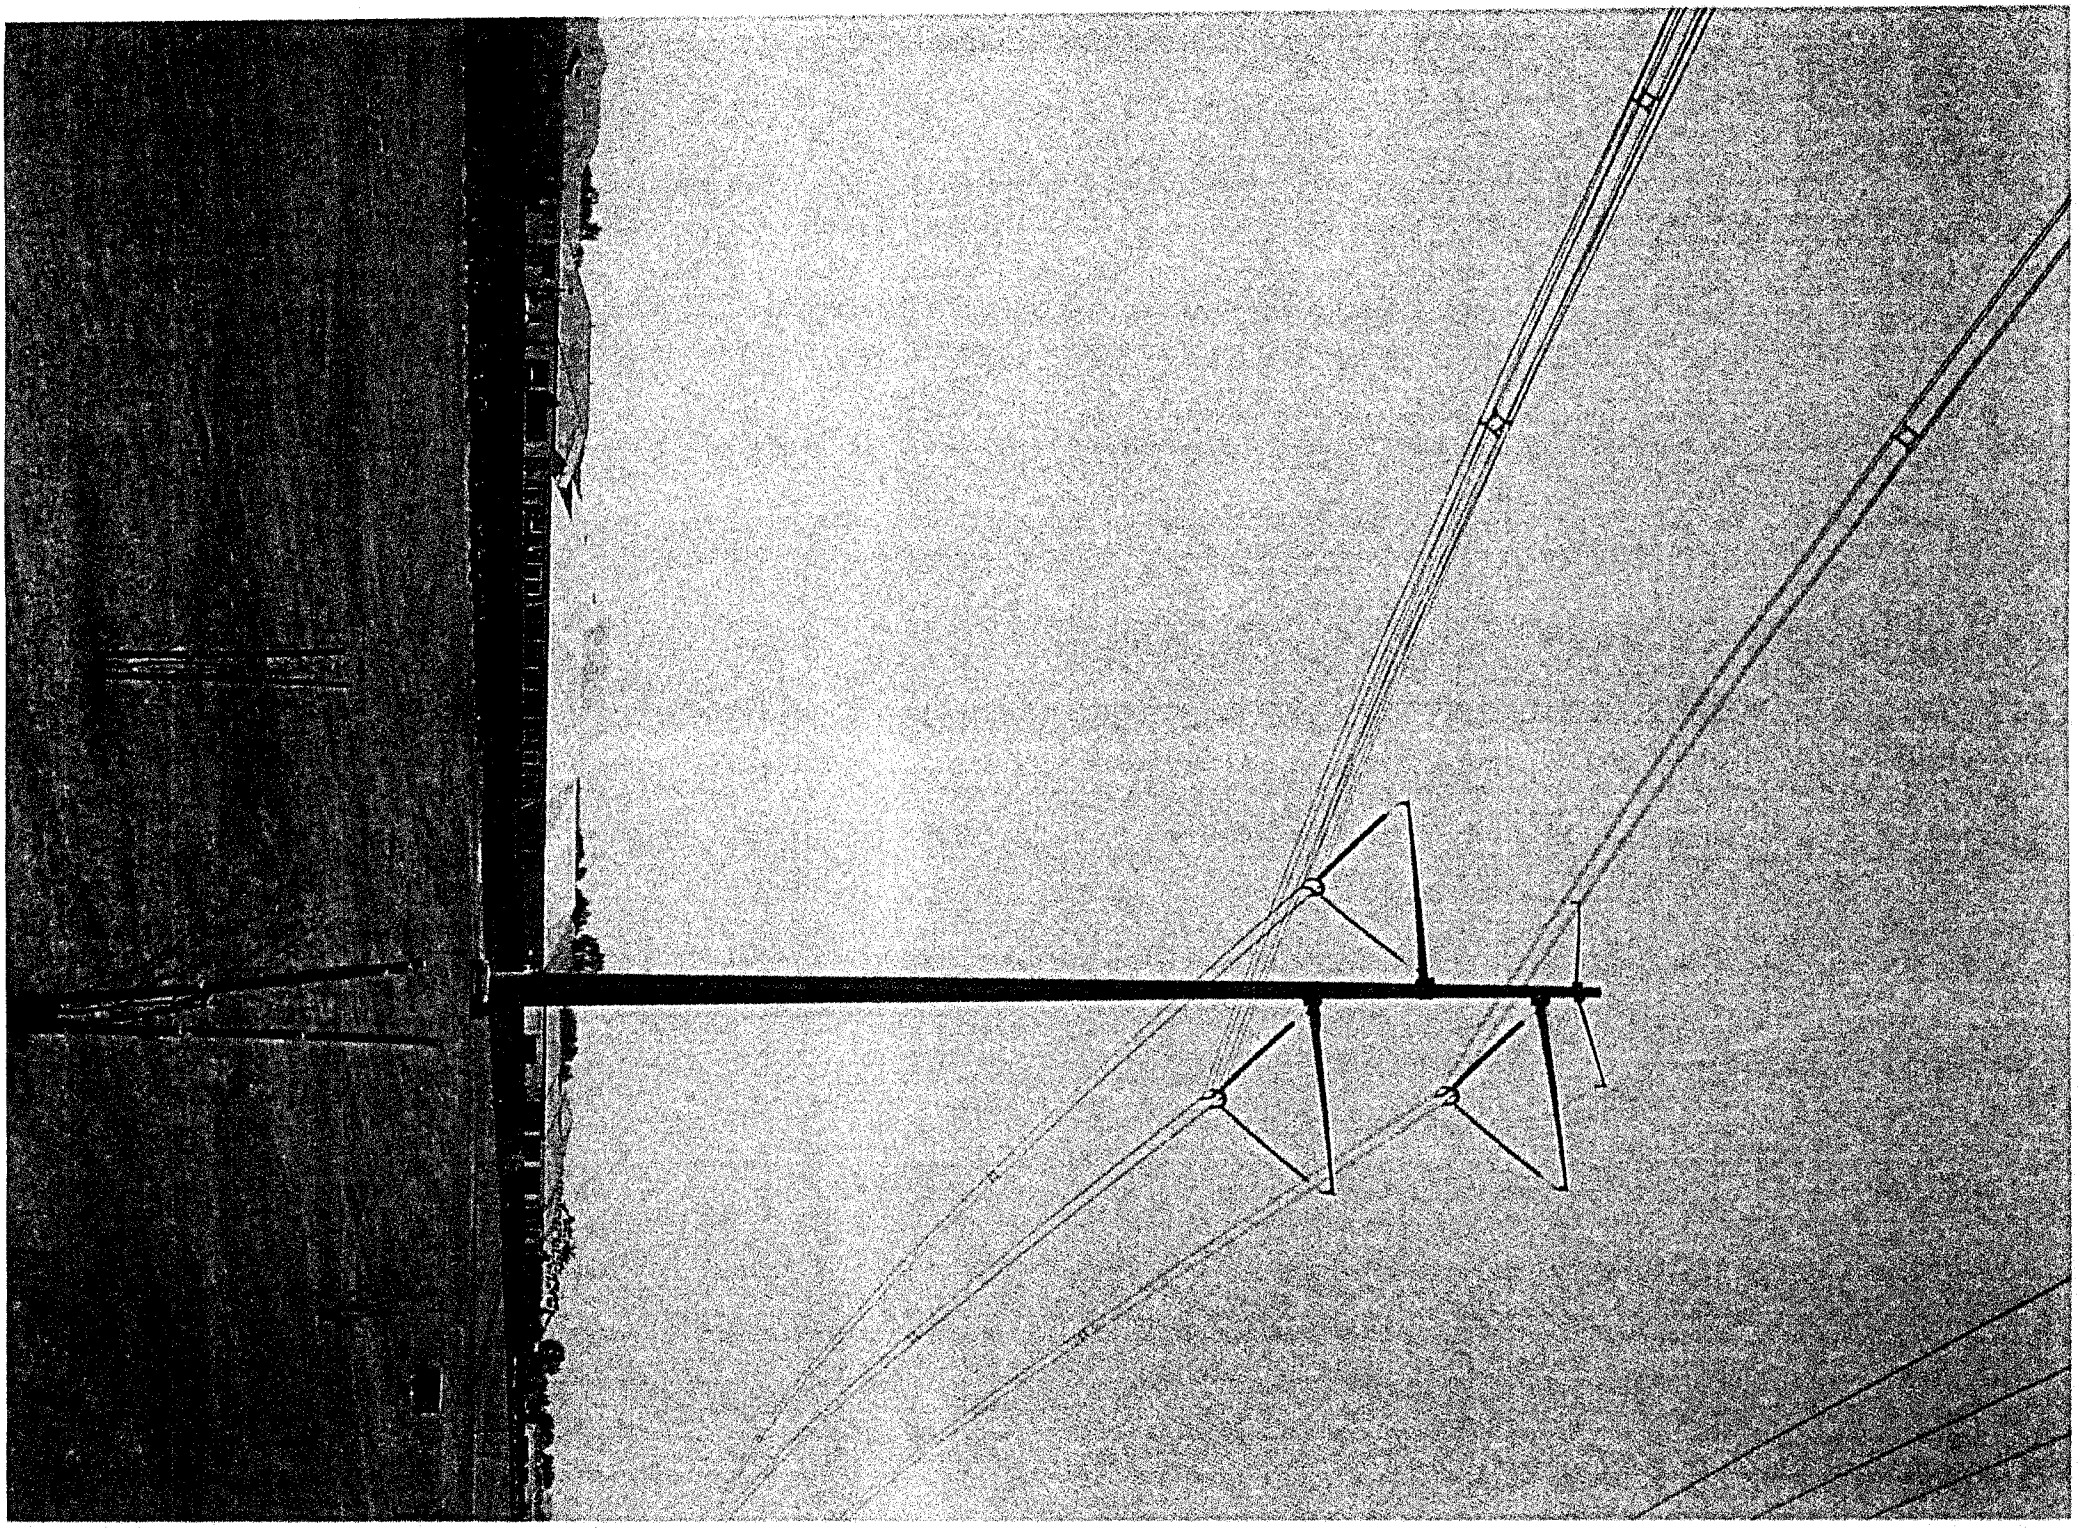

TMX - 500KV Delta Pole

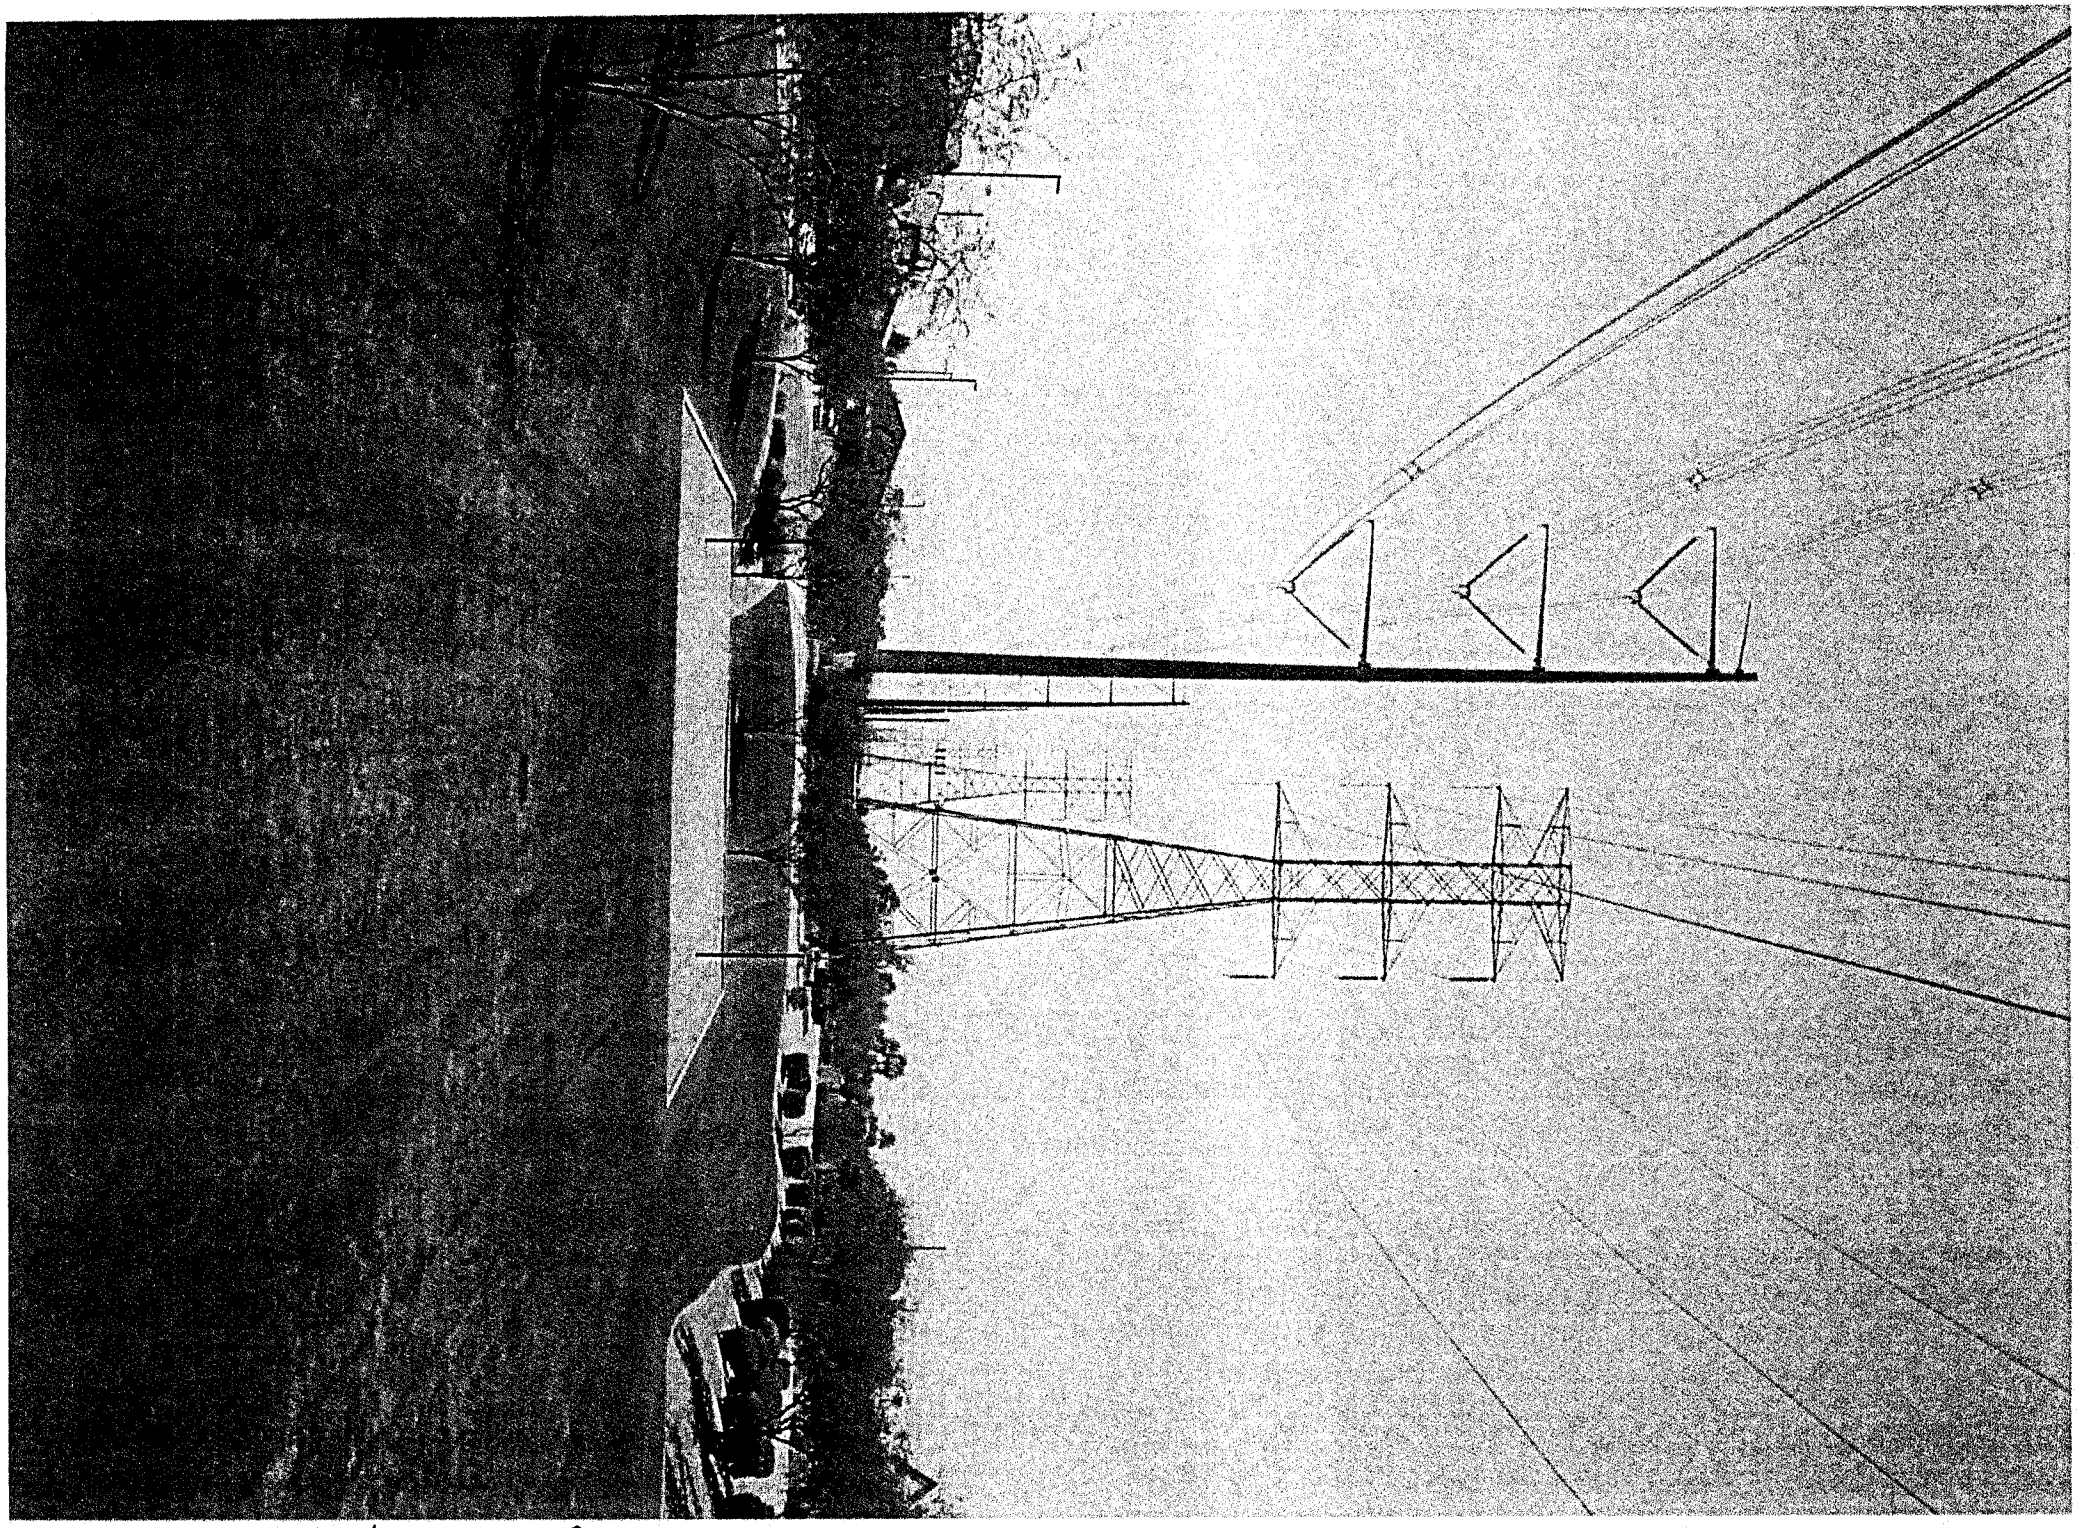

TMX—500KV Vertical Pole—230KV Towers